

PERFIDO WEISKOPF WAGSTAFF -GOETTEL 408 BOULEVARD OF THE ALLIES PITTSBURGH, PA 15219-1301 412.391.2884 PH 412.391.1657 FX WWW.PWWGARCH.COM NOTFORCONSTI

A-900L

THIRD FLOOR LAB PLAN

West Liberty, WV 26074

West Liberty University - Arnett Hall

NO. Addendum No. 1 C COPYRIGHT PERFIDO WEISKOPF WAGSTAFF + GOETTEL 2024 208 University Drive,


PWWG PROJECT NUMBER 22304.00 CONSTRUCTION DOCUMENTS 08/02/24 REVISIONS DATE DESCRIPTION 09/06/2024

LAB INFORMATION

LAB COMPONENTS AND FINISHES

((ADD ALT 01	CODE:	DESCRIPTION: PHENOLIC RESIN	MANURACTURER : FUNDERMAX OR TRESPA	STYLE:	COLOR/FINISH:
		ERS	EPOXY RESIN COUNTERTOP AND SINKS	DURCON OR KEMRESIN	1" THICK	BLACK
		LT-X	LABORATORY TABLE	KEWAUNEE SCIENTIFIC	FREESTANDING TABLE	BRIGHT WHITE WIT
		LC-X	BENCH MOUNTED SHELF UPRIGHTS	KEWAUNEE SCIENTIFIC	ALPHA BENCH MOUNTED	BRIGHT WHITE - MI
		RC-X	SALVAGED WOOD LAB CASEWORK	KEWAUNEE SCIENTIFIC	EXISTING	EXISTING
		LC-X	NEW METAL LAB CASEWORK	KEWAUNEE SCIENTIFIC	INSET STEEL FIXED CASEWORK	BRIGHT WHITE
		-	LAB CASEWORK HARDWARE	KEWAUNEE SCIENTIFIC	MATCH EXISTING	MATCH EXISTING
		-	LAB SINK FIXTURES	WATERSAVER / KEWAUNEE SCIENTIFIC	COLORTECH	CHROME
		LS-X	WALL MOUNTED LAB SHELVING	KEWAUNEE SCIENTIFIC	KEWAUNEE SCIENTIFIC	BRIGHT WHITE ME
			ELECTRICAL RACEWAY	LEGRAND	DUAL CHANNEL DATA/POWER ALS5200	WHITE

LAB DETAILS

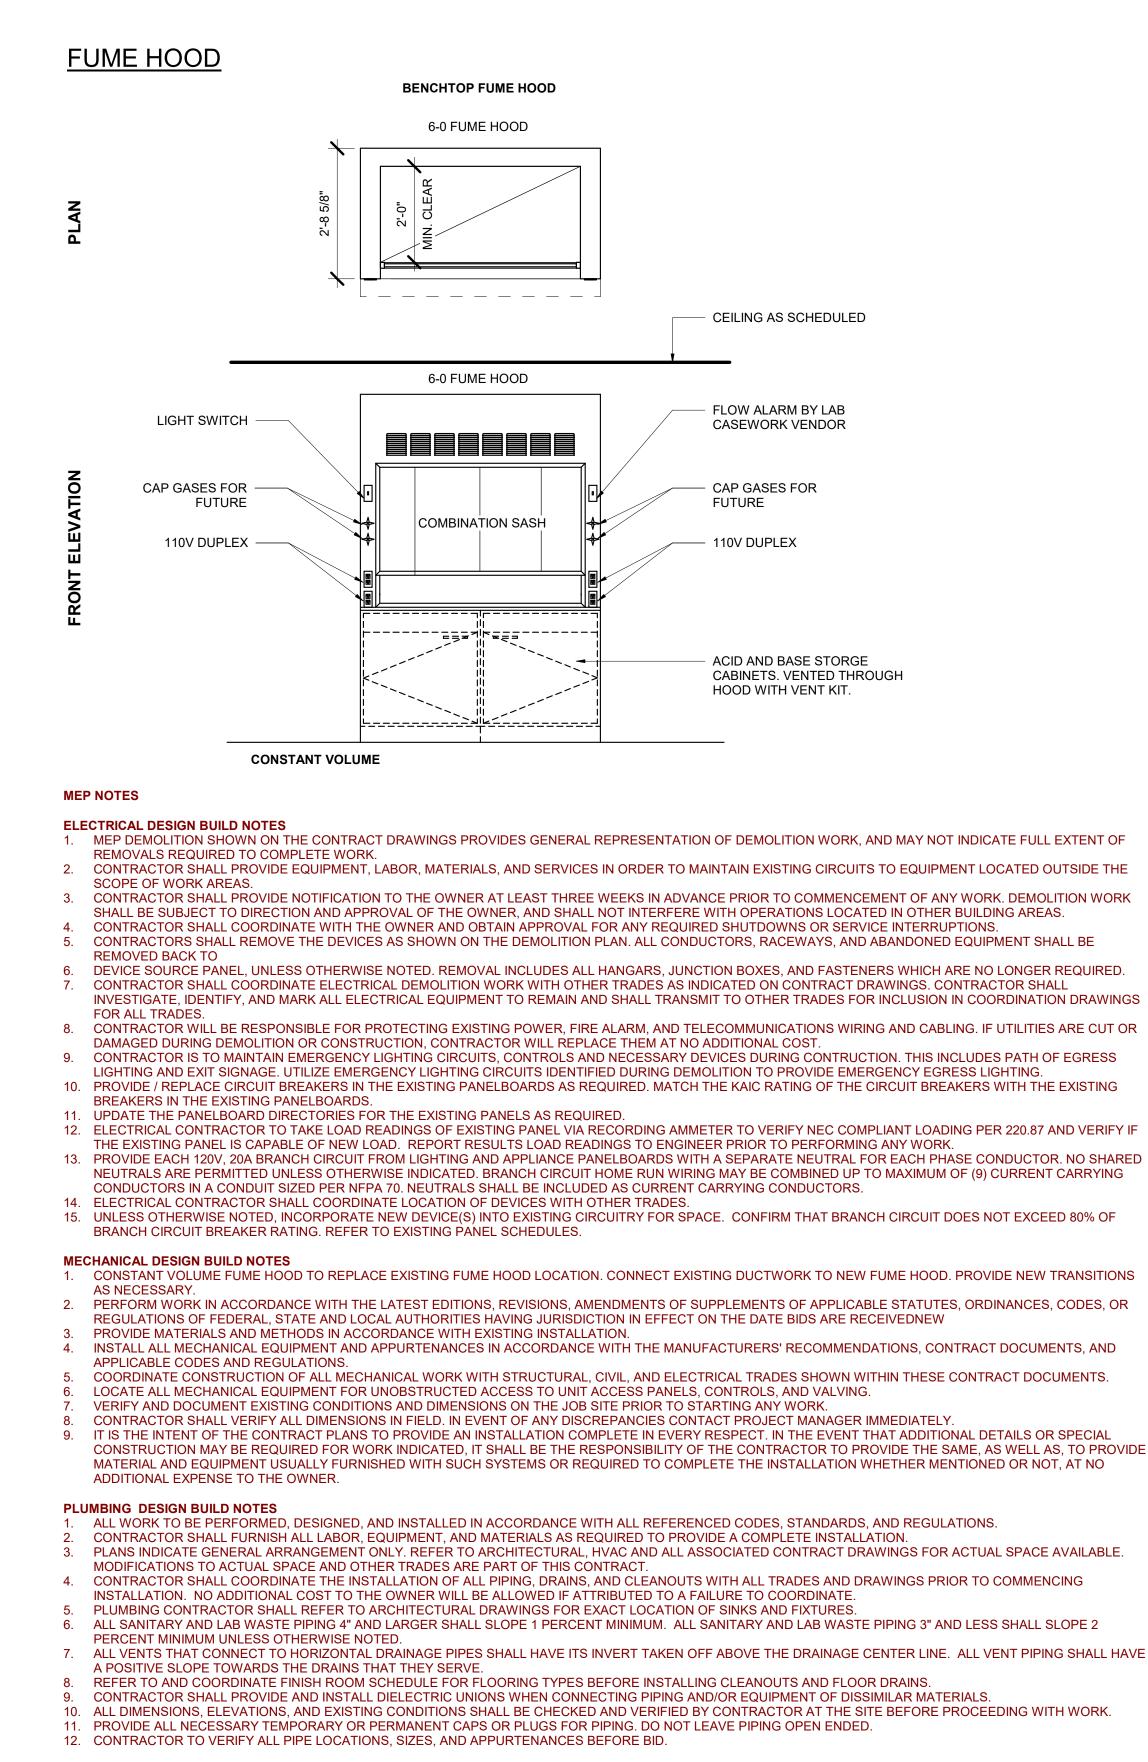

ITH EPOXY TOP METAL SHELVING

SECTION 11610 - LABORATORY FUME HOODS AND RELATED PRODUCTS

PART 1: DESCRIPTION OF WORK

1.00 SUMMARY AND SCOPE

A. Section Includes: Based on Kewaunee Scientific Corporation's Supreme Air Series fume hood design, furnish and install all fume hoods, work tops, and understructures. Furnishing and installing all filler panels, knee space panels and scribes as shown on drawings. B. Accessorization: Furnishing and delivering all service outlets, accessory fittings, electrical receptacles and Switches, as listed in these specifications, equipment schedules or as shown on drawings. Plumbing fixtures mounted on the fume hood superstructures shall be preplumbed per section 2.01.I. Electrical fixtures shall be prewired per section 2.01.J. The fume hood superstructure shall be listed to UL Standards for Safety by Underwriters Laboratories Inc. (UL). Final plumbing and electrical connections are the responsibility of those contractors fulfilling requirements of Divisions 15 and 16.

C. Removal of all debris, dirt and rubbish accumulated as a result of the installation of the fume hoods to an on-site container provided by others, leaving the premises clean and orderly. D. Related Divisions: 1. Division 12: Laboratory Casework

2. Division 15: Plumbing and Exhaust Ducting 3. Division 16: Electrical Fittings and Connections E. Related Publications:

1. ASHRAE Standard 110.1995 - Method of Testing Performance of Laboratory Fume Hoods 2. NSF STD#49 – Photometric Method of Testing 3. NIH03-112C - National Institute of Health Specification

4. UL – Underwriters Laboratories 5. ASTM D552 – Bending Test 6. NFPA-45 – National Fire Protection Association

1.01 BASIS OF WORK A. It is the intent of this specification to use Kewaunee Scientific Corporation, Statesville,

North Carolina, as the standard of construction for laboratory fume hoods. The construction standards of the Kewaunee Supreme Air product line shall provide the basis for quality and functional installation. 11610-FH-2 07/22 B. Supply all equipment in accordance with this specification. The offering of a product differing in materials and construction from this specification requires written approval. This approval must be obtained seven (7) days before the proposal deadline. Procedures for obtaining approval for an alternate manufacturer are defined in section 2.00 C. in this specification. C. General Contractors should secure a list of approved fume hood manufacturers from the architect as a protection against nonconformance to these specifications D. The owner/architect reserves the right to reject qualified or alternate proposals and to award based on product value where such

action assures the owner greater integrity of product. E. Submittals 1. Manufacturer's Data: Submit manufacturer's data and installation instructions for each type of fume hood. Provide data indicating compliance with ASHRAE Standard 110.1995.

2. Samples: Samples if called for will be reviewed for color, texture, and pattern only. Submit the following:

a. Hood interior lining, 6 by 6 inches. b. Hood enclosure, 6 by 6 inches, of color selected.

c. Operation sign(s). d. Shop Drawings:

Submit shop drawings for fume hoods showing plans, elevations, ends, crosssections, service run spaces, location and type of service 1) Coordinate shop drawings with other work involved.

2) Provide roughing-in drawings for mechanical and electrical services when required. 3) Provide face opening, air volume, and static pressure drop data.

1.02 STANDARD FUME HOOD PERFORMANCE REQUIREMENTS A. Fume hoods shall be of complete airfoil design to insure maximum operating efficiency. Foil sections at the front facias of the hood shall minimize eddying of air currents at the hood face and the rear baffle system shall minimize turbulence in the upper portion of the hood interior. B. Standard Fume Hood Types: Open Bypass: The hoods shall be of the bypass type. The fume hood design shall allow for automatic air 39. Sodium Hydroxide, 40% Watch glass bypass above the sash opening. The bypass shall limit the maximum air velocity through the face of the hood and provide for a constant 40. Sodium Hydroxide, Flake Watch glass

volume of air through the hood regardless of sash position. The bypass shall control the increase in face velocity as the sash is lowered to limit the maximum velocity to not more than three and one-half, times the velocity with the sash full open. C. Containment 1. Purpose: The purpose of this specification is to prequalify the performance of the bidder's laboratory fume hood before award of

contract. At his option, the owner or his representative may require the same tests to be performed and the same performance be achieved before acceptance of the hood after award of contract. The owner or his representative shall witness the tests. Failure to meet the performance specified shall be cause for rejection of the bidder.

2. Test Method: The hood shall be tested per the American Society of Heating, Refrigerating, and Air Conditioning Engineers (ASHRAE) Standard 110-1995 and by the Auxiliary Air Capture Test (Auxiliary Air hoods only). 3. Location of Tests and Test Facility: All tests referenced herein shall be performed in the bidder's fume hood test facility. Field testing is described in Section 3.01.F. The test facility shall meet the following requirements: a. The test facility shall have sufficient area so that a minimum of 5 feet of clear space is available in front of and on both sides of the hood for viewing tests. b. The facility's ventilation system shall have adequate heating and air conditioning so that room air temperatures can be maintained within the desired ranges 11610-FH-4 07/22

c. Room air currents in the test area shall be less than 20 FPM. d. The hood exhaust system shall be properly calibrated so that the desired exhaust air volumes can be easily attained. 4. Instrumentation, Equipment and Test Personnel: Qualified personnel to perform the tests shall be supplied by the bidder. instrumentation and equipment required shall be supplied by the bidder at his expense.

Required instrumentation shall include but not be limited to the following items: a. Thermal anemometer capable of measuring air velocities from 10 to 600 ft./minute

b. Three dozen one-half minute smoke candles c. Four ounces of Titanium Tetrachloride d. Supply of cotton throat swabs

e. ITI Leakmeter 120 calibrated to indicate concentration of sulfur hexafluoride or equivalent f. Flowmeter – 150 ml/minute capacity

g. Flowmeter – 15 L/minute capacity h. Four gas sampling bags – 8 liter capacity

i. Two vacuum pumps – 1 CFM capacity j. Two flow regulating valves

k. Two size 3 tanks of sulfur hexafluoride with a two-stage regulator or other tracer gas suitable for detector to be used. I. Three-way das valve

m. Mannequin, 5'7" in height, or reasonable human proportions with arms hanging at its side n. ASHRAE 110-1995 tracer gas ejector.

5. ASHRAE Standard 110-1995 Test: Hood shall be tested with a face velocity of 100 FPM full open vertically and at 100 FPM right, left and center 100% open horizontally. If horizontal openings are present, additional sash configurations and face velocities may be specified. The hood shall have a performance rating of 4.0 AM 0.01 or better wherein:

4.0 = tracer gas release in liters/minute AM = as manufactured

0.01 = level of control of tracer gas in parts per million (ppm). 1.03 QUALITY ASSURANCE

11610-FH-5 07/22

A. The laboratory fume hood manufacturer shall provide fume hood work tops and casework all manufactured or shipped from the same geographic location to assure proper staging, shipment and single source responsibility B. General Performance: Provide certification that fume hoods meet the performance requirements described in section 1.02.C

PART 2 – PRODUCTS 2.00 MANUFACTURERS

A. The basis of this specification is the Supreme Air fume hood as manufactured by Kewaunee Scientific Corporation, 2700 West Front Street, Statesville, North Carolina B. All laboratory equipment covered by the specification shall be the product of one manufacturer and be fabricated at one geographic location to assure shipping continuity and single-source responsibility. All quotations from a manufacturer other than Kewaunee Scientific shall contain a review of the following capabilities: 1. List of shop facilities

2. List of engineering and manufacturing personnel 3. Proof of financial ability to fulfill the contract

4. List of a minimum of ten installations over the last five years of comparable scope 5. Proof of project management and installation capabilities

. The selected manufacturer must warrant for a period of one-year starting (date of acceptance or occupancy, whichever comes first) that all products sold under the contract referenced above shall be free from defects in material and workmanship. Purchaser shall notify the manufacturer's representative immediately of any defective product. The manufacturer shall have a reasonable opportunity to inspect the goods. The purchaser shall return no product until receipt by purchaser of written shipping instructions from the manufacturer

2.01 MATERIALS AND CONSTRUCTION A. Fume Hood Superstructure Frame:

A free-standing rigid frame structure of steel angle shall be provided to support exterior panels and interior liner and baffle panels. To allow for maintenance and replacements, the interior liner panels shall be removable without disassembly of the frame structure and outer steel panels. Likewise, the exterior steel panels shall be removable without disassembly of the frame structure and inner liner panels. Fume hoods that require disassembly of the superstructure for liner replacement are not acceptable.

B. Fume Hood Interior Walls: Double wall ends, not more than 4" wide, shall be provided to maximize interior working area. The area between the double wall ends shall be closed to house the remote control valves. The front vertical fascia section shall have a full 135 degree 1" radius at the front leading edge to provide a streamlined section and insure smooth even flow of air into the hood. The vertical facias shall contain the required service controls, electrical switches and receptacles. The hood interior end panels and sash track shall be flush with the fascia to prevent eddy currents and back flow of air. C. Fume Hood Airfoil: A streamlined airfoil shall be integral at the bottom of the hood opening on bench and distillation hoods. This foil shall provide a nominal 1" open space between the foil and the top front edge of the work surface to direct an air stream across the work surface to prevent back flow of air. The airfoil shall extend back under the sash, so that the sash does not close the 1" opening. The foil

shall be removable to allow large equipment into the hood. The foil shall be of 12-gauge steel to resist denting and flexing. Walk-in hoods shall have a stop located at the bottom of the sash track that will ensure a nominal 1" opening between the bottom of the sash and the D. Fume Hood Top Panel:Standard Grille Bypass Configuration: The top front panel shall be of the same material as the exterior fascia. It shall have an integral grille stamped into the upper portion. The top front panel of the hood shall have an integral vision panel. It shall be located directly above the sash opening and in such a manner that it allows viewing into the top portion of the hood without the operator having to stoop or place their face inside the hood. E. Fume Hood Baffles (select one):

1. A stable, non-adjustable baffle with three fixed horizontal slots shall be provided to aid in distributing the flow of air into and through the hood. The baffle shall be spaced out 21/4" from the back liner. The baffle shall be removable for cleaning. F. Fume Hood Duct Collar: A 12" diameter polyethylene bell-mouthed duct collar shall be located in the top of the hood plenum chamber Coated common steel duct collars are not acceptable. G. Fume Hood Lighting: A one-tube, energy-efficient, T-5 fluorescent light fixture of the size given below shall be

rovided in the hood roof. Illumination at 13" above the worksurface shall be at least 100 footcandles. Hood Size, Ft. Nominal Fixture Length, Ft. 6 4. The light fixtures shall be isolated from the hood interior by a 1/4" thick tempered glass panel sealed from the hood cavity. Fixture shall be UL labeled. ion sash shall be provided. The sash shall have horizontal sliding glass panels in a vertical rising steel frame. The bottom of the sash frame shall have a full length metal handle. The sash track shall be a neutral colored polyvinyl chloride set flush with the interior liner panels to minimize turbulence. The sash shall be counterbalanced with a single weight to 40. Sodium Sulfide A A A A A

prevent tilting and binding during operation. The glass panels shall be 1/4" laminated safety float glass mounted on metal rollers in an aluminum track. J. Fume Hood Electrical Services: The hood superstructure shall be pre-wired and contain a UL label certifying acceptable wire gauge, connections, fixtures and wire color coding. Wiring electrical services shall consist of two duplex receptacles and a light switch. The duplex receptacles shall be 20 Amp., 125 volt AC, and 3-wire polarized grounded with ground fault interruption. The receptacles shall be of specification grade, side wired only, to insure a positive connection. The light switch shall be 20 Amp., 125 volt AC, and 3-wire polarized grounded. Wiring shall terminate in one 6" x 6" x 4" service junction box located on the fume hood roof. Final wiring and circuit dedication shall be by others.

K. Hood Work Surface Epoxy Resin: Hood work surface shall be 1-1/4" thick molded epoxy resin made in the form of a watertight pan, not less than 3/8" deep to contain spillage with a 6" wide safety ledge across the front edge. Top shall be manufactured at the same manufacturing location as the fume hood to assure proper cutout alignment and coordinated shipping. A cup drain flush with the recessed work surface shall be provided. The work surface and cup drain shall be available in either black or grey. M. Fume Hood Finish: After the component parts have been completely welded together and before finishing, they shall be given a pre-paint treatment to provide excellent adhesion of the finish system to the steel and to aid in the prevention of corrosion. Physical and chemical cleaning of the steel shall be accomplished by washing with an alkaline cleaner, followed by a spray treatment with a complex metallic phosphate solution to provide a uniform fine grained crystalline phosphate surface that shall provide both an excellent bond for the finish and enhance the protection provided by the finish against humidity and corrosive chemicals. After the phosphate treatment, the steel shall be dried and all steel surfaces shall be coated with a chemical and corrosion-resistant,

environmentally friendly, electrostatically applied powder coat finish. All components shall be individually painted, insuring that no area vulnerable to corrosion due to lack of paint coverage. The coating shall then be cured by baking at elevated temperatures to provide maximum properties of corrosion and wear resistance. The completed finish system in standard colors shall meet the performance test requirements specified under PERFORMANCE TEST RESULTS.

44. Sulfuric Acid. 96% Watch glass 45. Sulfuric Acid, 77% and Nitric Acid, 70%, equal parts Toluene Watch glass 46. Toluene Cotton ball & bottle 47. Trichloroethylene Cotton ball & bottle 48. Xylene Cotton ball & bottle 49. Zinc Chloride, Saturated Watch glass Where concentrations are indicated, percentages are by weight. visible effect from the hot water treatment. diameter mandrel, shall show no peeling or flaking off of the finish. diminishing hardness are 7-H, 6-H, 5-H, 4-H, 3-H, 2-H, F, HB, B (soft), 2-B, 3-B, 4-B, 5-B Q. Liner Tests – Chemical Spot Tests – 24 Hours

remove the surface dye. The test panel shall then be evaluated immediately after drying. 3. Ratings/Legend: 1 – KMER (Kewaunee Modified Epoxy Resin) DISCONTINUED A = No effect or slight change in gloss

2 – Glass Reinforced Polyester B = Slight change in gloss or color 3 – Stainless Steel 304 C = Slight etching or severe staining 4 – Stainless Steel 316 D = Swelling, pitting, or severe etching 5 – Reinforced Phenolic Resin RESULTS: 1 2 3 4 5 1. Acetic Acid 98% A C B B A 2. Acetone ** A A A A A A 3. Acid Dichromate A B A A A 4. Ammonium Hydroxide ** 28% A A B B A 5. Amyl Acetate ** A A A A A 6. Benzene ** A A A A A A

7. Butyl Alcohol ** A A A A A 8. Carbon Tetrachloride ** A B A A A 9. Chloroform ** A B A A A 10. Chromic Acid 60% B C C C A 11. Cresol A A A A A 12. Dichloroacetic Acid A A B A A 13. Dimethvlformamide A A A A A 11610-FH-13 07/22

14. Dioxane ** A A A A A A 15. Ethyl Acetate ** A A A A A 16. Ethyl Ether ** A A A A A 17. Ethyl Alcohol ** A A A A A 18. Formaldehvde A A A A A 19. Formic Acid 90% A B A A A 20. Furfural ** B C A A C 21. Gasoline ** A A A A A A 22. Hydrochloric Acid 37% A A B B A

23. Hydrofluoric Acid 48% B A D D A 24. Hydrogen Peroxide 30% A A A A A 25. Methyl Ethyl Ketone ** A A A A A 26. Methyl Alcohol ** A A A A A 27. Methylene Chloride ** A B A A A 28. Monochlorobenzene ** A A A A A 29. Naphthalene ** A A A A A 30. Nitric Acid 20% B A B A A

31. Nitric Acid 30% B B B A A 32. Nitric Acid 70% B B B A A 33. Phenol ** 85% A A A A A 34. Phosphoric Acid 85% A A B A A 35. Silver Nitrate B C A A C

36. Sodium Hydroxide 40% A A A A A 37. Sodium Hydroxide 20% A A A A A 38 Sodium Hydroxide 10% A A A A A 39. Sodium Hydroxide Flake A A A A A 41. Sulfuric Acid 77% A A C A A 42. Sulfuric Acid 96% C B C A C 43. Sulfuric Acid 33% A A C A A 44. Tincture of Iodine A C B B A 45. Toluene ** A A A A A 46. Trichlorethylene ** A A A A A

47. Xylene ** A A A A A A 48. Zinc Chloride A A B A A 49. Nitric 70%/Sulfuric Acid 77%* B B B A A * Equal parts of Nitric Acid 70% and Sulfuric Acid 77%. ** Indicates these solvents tested with cotton and jar method S. Fume Hood Base Cabinets 1. Standard Steel a. Unless otherwise indicated base units under hoods shall be fabricated of cold rolled prime grade roller leveled furniture steel. Gauges of steel used in construction shall be 18 gauge except as follows: b. Corner gussets for leveling bolts and apron corner braces, 12 gauge.

c. Hinge reinforcements, 14 gauge. e. Door assemblies and adjustable shelves, 20 gauge.

covering with an inverted 2-ounce wide mouth bottle to retard evaporation. All spot tests shall be

N. Performance Test Results (Chemical Spot Tests) a. Testing Procedure: Chemical spot tests for non-volatile chemicals shall be made by applying 5 drops of each reagent to the surface to be tested and covering with a 1-1/4" dia. watch glass, convex side down to confine the reagent. Spot tests of volatile chemicals shall be tested by placing a cotton ball saturated with reagent on the surface to be tested and

conducted in such a manner that the test surface is kept wet throughout the entire test period, and at a temperature of 77° ±3° F. For both methods, leave the reagents on the panel for a period of one hour. At the end of the test period, the reagents shall be flushed from the surface with water, and the surface scrubbed with a soft bristle brush under running water, rinsed and dried. Volatile solvent test areas shall be cleaned with a cotton swab soaked in the solvent used on the test area. Immediately prior to evaluation, 16 to 24 hours after the reagents are removed, the test surface shall be scrubbed with a damp paper towel and dried with paper towels.

b. Test Evaluation: Evaluation shall be based on the following rating system. Level 1 – Slight change in color or gloss.

Level 2 – Slight surface etching or severe staining. Level 3 – Pitting, cratering, swelling, or erosion of coating. Obvious and significant deterioration. After testing, panel shall show no more than three (3) Level 3 conditions.

Test No. Chemical Reagent Test Method 1. Acetate, Amyl Cotton ball & bottle 2. Acetate, Ethyl Cotton ball & bottle

Level 0 – No detectable change.

3. Acetic Acid, 98% Watch glass 4. Acetone Cotton ball & bottle

7. Alcohol, Ethyl Cotton ball & bottle

12. Chloroform Cotton ball & bottle

13. Chromic Acid, 60% Watch glass

14. Cresol Cotton ball & bottle

17. Dioxane Cotton ball & bottle

18. Ethyl Ether Cotton ball & bottle

20. Formic Acid, 90% Watch glass

21. Furfural Cotton ball & bottle

22. Gasoline Cotton ball & bottle

26. lodine, Tincture of Watch glass

30. Naphthalene Cotton ball & bottle

31. Nitric Acid, 20% Watch glass

32. Nitric Acid, 30% Watch glass

33. Nitric Acid, 70% Watch glass

34. Phenol, 90% Cotton ball & bottle 35. Phosphoric Acid, 85% Watch glass

42. Sulfuric Acid, 33% Watch glass

43. Sulfuric Acid, 77% Watch glass

23. Hydrochloric Acid, 37% Watch glass

11. Carbon Tetrachloride Cotton ball & bottle

19. Formaldehyde, 37% Cotton ball & bottle

10. Benzene Cotton ball & bottle

11610-FH-10 07/22

c. Test Reagents

5. Acid Dichromate, 5% Watch glass 6. Alcohol, Butyl Cotton ball & bottle

8. Alcohol, Methyl Cotton ball & bottle 9. Ammonium Hydroxide, 28% Watch glass

15. Dichlor Acetic Acid Cotton ball & bottle 16. Dimethylformanide Cotton ball & bottle

Hydrofluoric Acid, 48% Watch glass 25. Hydrogen Peroxide, 3% Watch glass

27. Methyl Ethyl Ketone Cotton ball & bottle 28. Methylene Cloride Cotton ball & bottle 29. Mono Chlorobenzene Cotton ball & bottle

36. Silver Nitrate, Saturated Watch glass 37. Sodium Hydroxide, 10% Watch glass 38. Sodium Hydroxide, 20% Watch glass

41. Sodium Sulfide, Saturated Watch glass

O. Performance Test Results (Heat Resistance): Hot water (190° F - 205° F) shall be allowed to trickle (with a steady stream at a rate not less than 6 ounces per minute) on the finished surface, which shall be set at an angle of 45° from horizontal, for a period of five minutes. After cooling and wiping dry, the finish shall show no

P. Performance Test Results (Impact Resistance): A one-pound ball (approximately 2" diameter) shall be dropped from a distance of 12 inches onto the finished surface of steel panel supported underneath by a solid surface. There shall be no evidence of cracks or checks in the finish due to impact upon close eye-ball examination Q. Performance Test Results (Bending Test): An 18 gauge steel strip, finished as specified, when bent 1800 over a 1/2"

R. Performance Test Results (Adhesion): Ninety or more squares of the test sample shall remain coated after the scratch adhesion test. Two sets of eleven parallel lines 1/16" apart shall be cut with a razor blade to intersect at right angle thus forming a grid of 100 squares. The cuts shall be made just deep enough to go through the coating, but not into the substrate. They shall then be brushed lightly with a soft brush. Examine under 100 foot-candles of illumination. Note: This test is based on ASTM D2197-68, "Standard Method of Test for Adhesion of Organic Coatings". S. Performance Test Results (Hardness): The test sample shall have a hardness of 4-H using the pencil hardness test. Pencils, regardless of their brand are valued in this way: 8-H is the hardest, and next in order of

(which is the softest). The pencils shall be sharpened on emery paper to a wide sharp edge. Pencils of increasing hardness shall be pushed across the paint film in a chisel-like manner until one is found that will cut or scratch the film. The pencil used before that one-that is, the hardest pencil that will not rupture the film-is then used to express or designate the T. Fume Hood Dimensions: Double wall end panel thickness shall not exceed 4". Interior clear working height shall be not less than 41-3/4" at any location in the interior of the hood on bench hoods and 76" on walk-in and distillation hoods. Interior depth

from the back of the sash to the front of the rear baffle shall not be less than 25-1/4". The sash opening shall be not less than 28" in height above the work surface on bench hoods and 60" on walk-in and distillation hoods. U. Fume Hood Liners:11610-FH-12 07/22 KEMGLASS Reinforced Polyester Lining: Interior liner panels shall be 1/4" thick fiberglass reinforced polyester sheet. Interior liner panels shall be fastened using stainless steel screws with plastic covered

1. Chemical spot test shall be made by applying 10 drops (approximately 1/2 cc) of each reagent to the surface to be tested. Each reagent (except those marked **) shall be covered with a 1-1/2" diameter watch glass, convex side down to confine the reagent. Spot tests of volatile solvents marked ** shall be tested as follows: A 1" or larger ball of cotton shall be saturated with the solvent and placed on the surfaces to be tested. The cotton ball shall then be covered by an inverted 2-ounce, wide mouth bottle to retard evaporation. All spot tests shall be conducted in such a manner that the test surface is kept wet throughout the entire 24-hour test period and at a temperature of 77 degrees F. + 3 degrees F. 2. At the end of the test period, the reagents shall be flushed from the surfaces with water and the surface scrubbed with a soft bristle brush under running water, rinsed, and dried. Volatile solvent test areas shall be cleaned with a cotton swab soaked in the solvent used on the test area. Spots where dyes have dried shall be cleaned with a cotton swab soaked in alcohol to

d. Top and intermediate front horizontal rails, apron rails and reinforcement gussets, 16 gauge.

f. Performance of the painted surfaces shall match that of the fume hood outer panels.

2. Special Purpose Cabinets for Use Under Fume Hoods:

a. Acid Storage Cabinets: Where indicated acid storage cabinets shall use the same gauges of steel and construction features as other base cabinets. In addition, they shall have a one-piece liner insert made of linear low-density polyethylene. The liner insert shall form a oneinch pan at the bottom to retain spillage. Each door will have a set of louvers at the top and bottom. The door shall be lined with a polyethylene sheet. Each cabinet shall be vented into the fume hood with a 1-1/2" vent pipe. Providing a positive airflow directly into the fume hood exhaust system. T. Accessories:

1. Filters and Housings: Where called for, a filter housing shall be provided above the hoods. The housing shall contain an absolute filter (99.97% efficient for 0.3 micron particles) and a furnace type pre-filter. The housing shall form a rigid, self-supporting assembly and have a gasketed front cover to allow replacement of the filters without disturbing the ductwork. The filter housing shall be fabricated of cold rolled steel with a chemical resistant finish. 2. Alarms (Optional – Choose One):

a. Low Face Velocity Alarm: Fume hoods shall be provided with an electronic alarm system to detect low hood face velocities. The alarm system shall sense the actual face velocity of the hood regardless of sash position. The system shall have air velocity sensing thermistor located in the monitor on the face of the hood. The monitor shall have a green light activated when the face velocity is above the set point and a red light and audible alarm which are activated when the face velocity is below the set point. The audible alarm can be acknowledged and silences with mute switch on panel. When the mute is activated, it automatically resets itself when face velocity again rises above calibrated set point. The set point is to be factory set and calibrated at approximately 70 FPM. Field calibration is possible with adjustment of recessed zero potentiometer on front of unit.

PART 3 – EXECUTION – SUPREME AIR SERIES FUME HOOD AND RELATED PRODUCTS

3.00 SITE EXAMINATIONThe owner and/or his representative shall certify building conditions conducive to the installation of a finished goods product, including all critical dimensions. 3.01 INSTALLATION

A. Preparation: Prior to beginning installation of fume hood, check and verify that no irregularities exist that would affect quality of execution of work specified.

B. Coordination: Coordinate the work of the Section with the schedule and other requirements of other work being performed in the area at the same time both with regard to mechanical and electrical connections to and in the fume hoods and the general construction work.

C. Performance: Install fume hoods, plumb, level, rigid, securely anchored to building and adjacent furniture in proper location, in accordance with manufacturer's instructions and the approved shop drawings. Provide filler panels between top of hood and ceiling. Securely attach access panels but provide for easy removal and secure reattachment. Do not install any damaged units.

D. Adjust and Clean: 1. After installations are complete, adjust all moving parts for smooth operation.

2. Remove all packing materials and debris resulting from this work, and turn over the fume hoods to the Owner clean and polished both inside and out. 3. Repair or remove and replace defective work, as directed by owner and/or his representative upon completion of installation

E. Protection: 1. Provide reasonable protective measures to prevent casework and equipment from being exposed to other construction

2. Advise owner and/or his representative of procedures and precautions for protection of material, installed laboratory casework and fixtures from damage by work of other trades. F. Certification:

1. Fume Hood Manufacturer shall field test a random sample of 20% of the installed units using ANSI/ASHRAE 110-1995 to a control level of Al 0.01 ppm or better. 2. Project substantial completion shall be withheld until all required fume hood certification letters, tests, and reports have been submitted to and approved by the Architect.

SECTION 12345 - LABORATORY CASEWORK AND RELATED PRODUCTS (ALPHA SYSTEM)

PART 1: DESCRIPTION OF WORK 1.00 SUMMARY AND SCOPE

A. Section Includes: 1. Using Kewaunee Scientific Corporation, ALPHA SYSTEM Laboratory Furniture as a modular component system used to create work space and storage assemblies. Furnish all cabinets and casework, including tops, ledges, supporting structures, and miscellaneous items equipment as listed in these specifications, or equipment schedules, including delivery to the building, setting in place, leveling, scribing to walls and floors as required. Furnishing and installing all filler panels, knee space panels and scribes as shown on drawings. 2. Furnishing and delivering all utility service outlet accessory fittings, electrical receptacles and switches, as listed in these specifications, equipment schedules or as shown on drawings as mounted on the laboratory furniture. The abovedefined items shall be furnished with supply tank nipples and lock nuts, loose in boxes and properly marked. All plumbing and electrical fittings will be packaged separately and properly marked for delivery to the appropriate contractor.

3. Furnishing and delivering, packed in boxes for installation by the mechanical contractor, all laboratory sinks, cup sinks or drains, drain troughs, overflows and sink outlets with integral tailpieces, which occur above the floor, and where these items are part of the equipment or listed in the specifications, equipment schedules or shown on the drawings. Integral tailpieces when required shall be in accordance with the manufacturer's standards. All tailpieces shall be furnished less the couplings required to connect them to the drain piping system. 4. Furnishing service strip supports where specified, and setting in place service tunnels, service turrets, supporting

structures and reagent racks of the type shown on the details. 5. Removal of all debris, dirt and rubbish accumulated as a result of the installation of the laboratory furniture to an onsite container provided by others, leaving the premises clean and orderly. B. Related Divisions:

1. Divisions 5 & 6: Behind-the-Wall Blocking and Studs 2. Division 9: Base Molding

3. Division 11: Chemical Fume Hoods 4. Division 15: Plumbing

5. Division 16: Electrical Fittings and Connections C. Related Publications

1. SEFA 3 - Scientific Equipment and Furniture Association 2. SEFA 8 - Scientific Equipment and Furniture Association

3. NFPA 30 - National Fire Protection Association

4. NFPA-45 - National Fire Protection Association UL - Underwriters Laboratories

6. ASTM D552 - Bending Test 1.01 BASIS OF WORK

A. It is the intent of this specification to use Kewaunee Scientific Corporation, ALPHA SYSTEM Laboratory Furniture as the standard of construction for laboratory furniture. The construction standards of this product line shall provide the basis for quality and functional 12345-A-2 08/07 installation B. Supply all equipment in accordance with this specification. The offering of a product differing in materials and construction from this specification requires written approval from the owner/architect. This approval must be obtained seven (7) days before the quotation deadline. Procedures for obtaining approval for an alternate manufacturer are defined in section 2.00.C in this specification. C. General Contractors should secure a list of approved laboratory furniture manufacturers from the architect as a

protection against non-conformance to these specifications. D. Participants in the quotation process have the option of clarifying deviations to the specified design, construction, or materials. Without such clarifications, sealed quotations to the owner or owner representative will be construed as being in total conformance to the requirements of the specification. E. The owner / owner representative reserves the right to reject qualified or alternate proposals and to award based on product value where such action assures the owner greater integrity of product.

1.02 QUALITY ASSURANCE A. The modular component system laboratory furniture contractor shall also provide work tops and fume hoods all manufactured or shipped from the same geographic location to assure proper staging, shipment and single source

B. General Performance: Provide certification that furniture shall meet the performance requirements described in SEFA

1.03 SUBMITTALS A. Manufacturer's Data: Submit manufacturer's data and installation instructions for each type of casework. Provide data indicating compliance with SEFA Standard#8. B. Samples

Samples from non-specified manufacturers will be required and reviewed per specification. Samples shall be delivered, at no cost to the architect or owner to a destination set forth by the architect or owner. This must be done seven (7) days before quotation deadline as a condition of approval of each bidder. Samples shall be full size, production type samples. Miniature, or "Show Room" type samples are not acceptable. Furnish the following:

1. Support structure, suspended cabinet and required hardware. 2. One sample of all top materials shown or called for, of sufficient size to perform finish requirement tests. 3. Sample of all mechanical service fittings, locks, door pulls, hinges, and interior hardware.

C. Shop Drawings: Submit shop drawings for furniture assemblies showing plans, elevations, ends, crosssections, service run spaces, location and type of service fittings. 1. Coordinate shop drawings with other work involved.

2. Provide roughing-in drawings for mechanical and electrical services when required.

PART 2 – PRODUCTS

2.00 MANUFACTURERS

A. The basis of this specification is a modular component system manufactured according to the standards used by Kewaunee Scientific Corporation, 2700 Front Street, Statesville, North Carolina. The specified design is Alpha System. All laboratory equipment covered by the 12345-A-3 08/07 specification shall be the product of one manufacturer and be fabricated at one geographic location to assure shipping continuity and single-source responsibility. All quotations from a manufacturer other than Kewaunee Scientific Corporation shall contain a review of the following capabilities: 1. List of shop facilities

2. List of engineering and manufacturing personnel 3. Proof of financial ability to fulfill the contract

4. List of a minimum of ten (10) installations over the last five (5) years of comparable scope 5. Proof of project management and installation capabilities

B. The selected manufacturer must warrant for a period of one-year starting (date of acceptance or occupancy, whichever comes first) that all products sold under the contract referenced above shall be free from defects in material and workmanship. Purchaser shall notify the manufacturer's representative immediately of any defective product. The manufacturer shall have a reasonable opportunity to inspect the goods. The purchaser shall return no product until receipt by purchaser of written shipping instructions from the manufacturer. C. All manufacturers other than those mentioned in section 2.00.A. must submit samples made in accordance with this specification. Samples shall be delivered at no cost to the architect or owner to a destination set forth by the architect or owner. Sample delivery must be done seven (7) days before the quotation deadline. Samples shall be full size,

production type samples. Miniature, or "Show Room" type samples are not acceptable. . One full support module with specified shelving, support frame, countertop and hardware 2. One 48" base cabinet with two doors and drawers. D. The above samples of the successful manufacturer will be impounded by the architect or owner to insure that material

delivered to jobsite conforms in every respect to the samples submitted. 2.01 MATERIALS

A. General Requirements:


It is the intent of this specification to provide a high quality adjustable casework system designed for the laboratory environment. Major structural components are made from a combination of extruded aluminum and high quality cold rolled steel.

B. Sheet Steel: Cold rolled sheet steel shall be prime grade; roller leveled, and shall be treated at the mill to be free of scale, ragged edges, deep scratches or other injurious effects. All gauges shall be U.S. Standard. PART 2 – PRODUCTS

2.01 MANUFACTURERS

A. Epoxy counter tops shall be Kemresin as supplied by Kewaunee Scientific located in Statesville, NC. Substitutions may be accepted after following the substitution request as found in Division 1 documentation. In all cases, counter tops shall be manufactured by the same Division 12 casework and Div 11 fume hoods manufacturer. B. Qualified manufacturers shall have 10+ years of documented and successful installations. Manufacturers shall have United States based modern production facility consisting of loading docks, material handling, raw material formulation, pour, bake, setting, CNC manufacturing and storage capabilities. Qualified manufacturer shall employ the use of a closed mold system. 2.02 MATERIALS

2.03 Epoxy resin shall be a monolithic poured material consistent throughout material thickness. The finished surface shall have a smooth finish resulting in enhanced stain, scratch and abrasion resistance.



LAB DETAILS

208 University Drive, West Liberty, WV 26074 West Liberty University - Arnett Hall

C COPYRIGHT PERFIDO WEISKOPF WAGSTAFF + GOETTEL 2024

DESCRIPTION DATE

PWWG PROJECT NUMBER 22304.00 CONSTRUCTION DOCUMENTS 08/02/24 REVISIONS NO.

408 BOULEVARD OF THE ALLIES PITTSBURGH, PA 15219-1301 412.391.2884 PH 412.391.1657 FX WWW.PWWGARCH.COM

PERFIDO WEISKOPF WAGSTAFF GOETTEL